


B3 Cabinet
 AC Power Drop
 FS 408L
 P328M

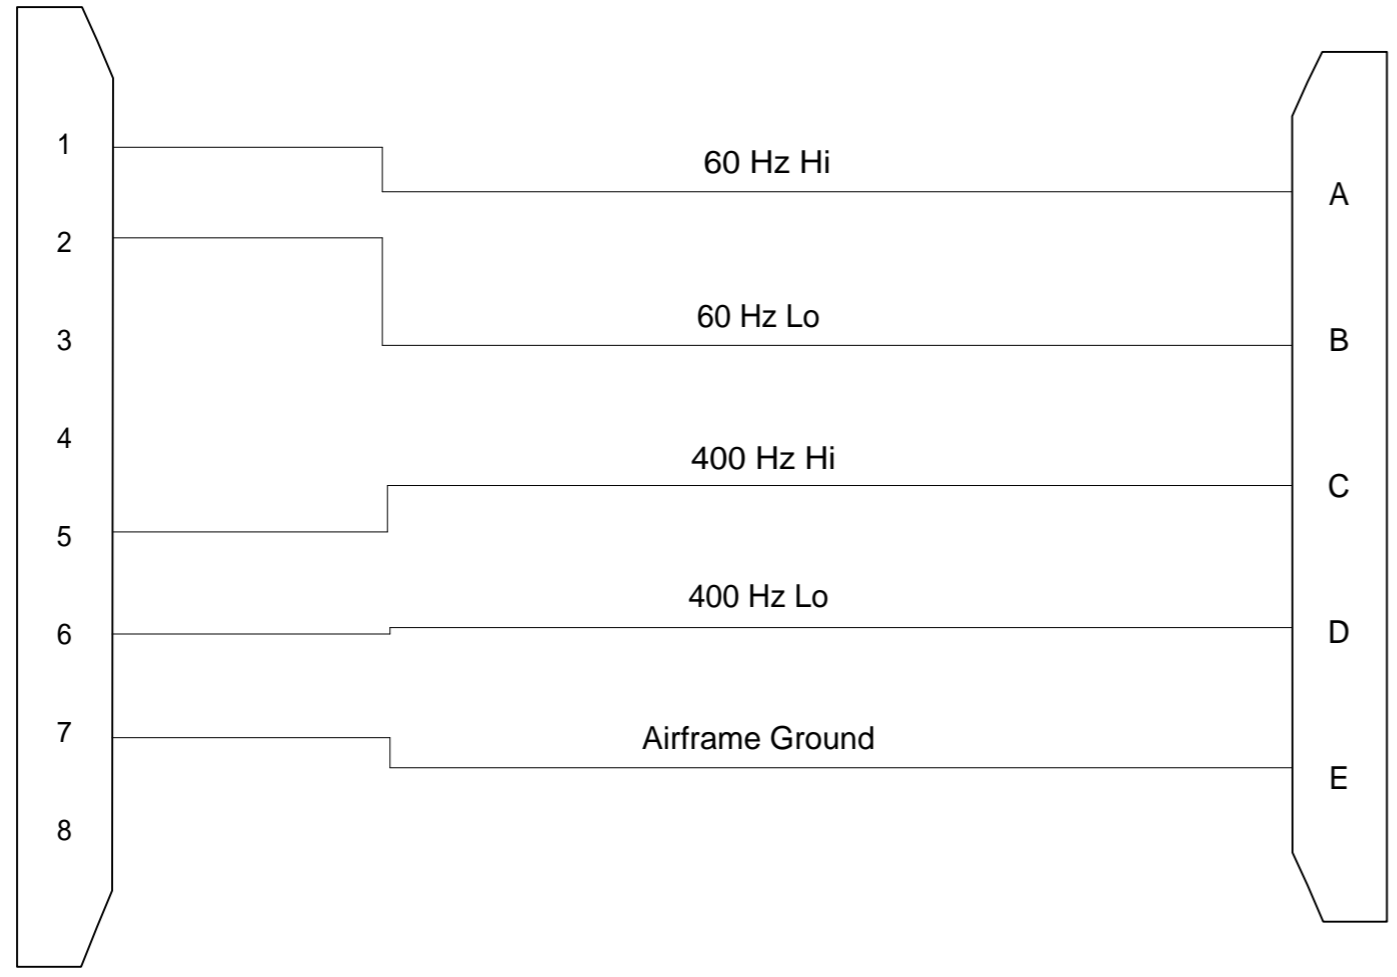

WLOPC Instrument
 Mounted in B3 Cabinet

3.5 Amps 400 Hz
 1 Amp 60 Hz Bus 1B

Located:
 B3 Cabinet
 Aisle Face
 Forward Side
 28" High

M83723/76W1808N

MS3476W14-5S

M85049/52-1-18W SR

M85049/52-1-14W SR

Notes:

- M22759/34-16-9 Wire or equivalent
- 60 Inches Long
- 60 Hz could be switched to Bus 2 if load analysis requires it (Cable built to Bus 1B).

BY	NAME	DATE	NATIONAL OCEANIC AND ATMOSPHERIC ADMINISTRATION AIRCRAFT OPERATIONS CENTER HANGAR 5, MACDILL AFB, FLORIDA 33621		
DRAWN	TML	7/24/06	TITLE		
CHECKED			WLOPC Power Cord B3 Cabinet Ozone '06		
STRESS			REF		
PROJECTS			CODE IDENT NO.	SIZE DWG NO.	REV.
PROJECTS				XX-XXXXXX	
APPROVED			SCALE: NONE filename.dxf SHEET 1 OF 1		